

Email to : Adam Ryan
Taylor Wimpey
Email address : adam.ryan@taylorwimpey.com
From : Steve Ellis
Date : 27 March 2012
Subject : Environmental Noise and Train Vibration Assessment – residential development at Rhoose Point, Vale of Glamorgan
Report No : 6993

Introduction

The **Industrial Noise & Vibration Centre Limited (INVC)** was requested by Taylor Wimpey to assess the train noise and vibration levels at the above site.

This report gives the results of the noise and vibration measurements undertaken on 22 March 2012 and compares the results with the advice given in Planning Guidance (Wales) Technical Advice Note 11 (Noise) and British Standard BS 6472 : 2008 "Guide to evaluation of human exposure to vibration in buildings Part 1 : vibration sources other than blasting".

Figure 1 shows the site in relation to the surrounding area and in particular, the railway line and existing housing.



INVC IN CONFIDENCE

This is a document prepared for the client by **INVC**. Recipients may not pass this document to any person outside the client's business without written consent from the **INVC**. Neither **INVC**, nor any person acting on its behalf, makes any warranty, express or implied with respect to the use of any information, method or process disclosed in this document or that such use may not infringe the rights of any third party or assumes any liabilities with respect to the use of, or for damages resulting in any way from the use of any information, apparatus, method or process disclosed in the document.

© INVC 2012

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted, in any form or by any means electronic, mechanical, photocopying, recording or otherwise outside the client's business without the written permission of the Industrial Noise & Vibration Centre Limited, 889 Plymouth Road, Slough, Berkshire, SL1 4LP. (Registered in England No. 1981938)

Noise and vibration measurements

Ambient and background noise measurements were taken at location 1, as shown on Figure 1. The 'A' weighted noise levels were taken at a height of approximately 1.5m above local ground level, in free field conditions using calibrated instrumentation conforming to the Type 1 specification of BS 61672 - 1 - 2003. In addition, specific noise measurements were taken of a goods train and the local diesel turbos (Figures 5 and 6) that passed the measurement location. During the measurement period the weather was good, with clear skies and wind speeds of less than 3m/sec.

Figures 2, 3 and 4 show a general view of the site, a goods train and a typical diesel turbo train respectively.

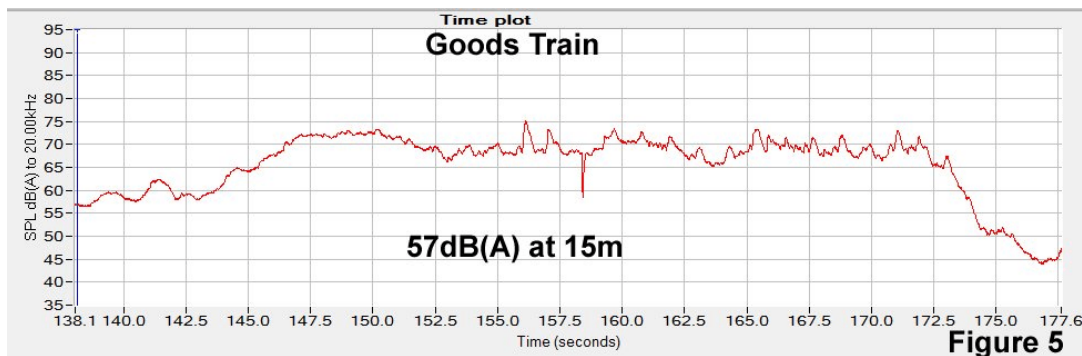


Table 1 gives the results of the noise measurements undertaken.

TABLE 1

Start Time	L _{Aeq}	L _{A10}	L _{A50}	L _{A90}
11:30	59	61	49	44
11:40	52	50	46	42
11:50	43	46	42	39
12:00	57	55	44	40
12:10	45	46	42	40
12:20	47	48	43	39
12:30	47	48	43	41
12:40	59	50	43	40
12:50	45	48	42	39
13:00	55	47	42	39
13:10	43	45	42	39
13:20	41	44	40	37
13:30	47	47	40	37
13:40	42	46	41	38
13:50	45	46	41	38
14:00	55	47	40	37
14:10	48	48	41	39
14:20	41	44	40	37
Average	53	48	42	39

From the above results it can be seen that the ambient (L_{Aeq}) noise level is 53 dB with an attendant background (L_{A90}) level in the region of 39 dB.



Vibration measurements were undertaken based on the criteria specified in British Standard BS 6472 : 2008 "Guide to evaluation of human exposure to vibration in buildings Part 1 : vibration sources other than blasting". The measurements of the goods train and diesel turbos were taken at the same time as the noise measurements and at the same location, which is considered to be typical of the location for the nearest houses on the site relative to the railway line. Vibration levels were below a point which could be detected and hence are below the "low probability of adverse comment" criterion given in BS 6472 and therefore vibration from the trains is not an issue.

Predicted noise levels

The following table, 2, gives the number of trains that have been used to calculate the free field noise levels at location 1, as shown on Figure 1. The number of trains used is based on the timetable as far as possible and are considered worst case.

TABLE 2

Train type	Number of trains		SEL dB(A)	16 hour free field (07:00 - 23:00)	8 hour free field (23:00 - 07:00)
	16 hours	8 hours		L_{Aeq} dB	L_{Aeq} dB
Diesel turbo	32	8	64	31	28
Goods	8	2	73	34	31
			Total	36	33

From the above it can be seen that the free field 16 hour L_{Aeq} at location 1 is 35 dB and the 8 hour L_{Aeq} is 33 dB.

Discussion of results

In order to put the measured noise levels into context, reference has been made to Planning Guidance (Wales) Technical Advice Note (Wales) 11. The document makes reference to various noise exposure categories, A, B, C and D, for road traffic and train noise.

	Time period	L_{Aeq}	Comments
A	07:00 - 23:00 23:00 - 07:00	<u>Rail traffic</u> < 55 16 hr L_{Aeq} < 45 8 hr L_{Aeq}	Noise need not be considered as a determining factor in granting planning permission, although the noise level at the high end of the category should not be regarded as a desirable level.
B	07:00 - 23:00 23:00 - 07:00	<u>Rail traffic</u> 55 - 66 16 hr L_{Aeq} 45 - 59 8 hr L_{Aeq}	Noise should be taken into account when determining planning applications and where appropriate, conditions imposed to ensure an adequate level of protection against noise.
C	07:00 - 23:00 23:00 - 07:00	<u>Rail traffic</u> 66 - 74 16 hr L_{Aeq} 59 - 66 8 hr L_{Aeq}	Planning permission should not normally be granted. Where it is considered that permission should be granted, for example because there are no alternative quieter sites available, conditions should be imposed to ensure a commensurate level of protection against noise.
D	07:00 - 23:00 23:00 - 07:00	<u>Rail traffic</u> > 74 16 hr L_{Aeq} > 66 8 hr L_{Aeq}	Planning permission should normally be refused.

The measured levels, which take account of the train noise, place the development into Category A.

The Vale of Glamorgan Council set the following noise conditions for railway noise and vibration.

“Railway Noise

*Prior to commencement of development a scheme shall be submitted and approved in writing by the Local Planning Authority to provide that all habitable rooms exposed to external daily noise in excess of 66 dB(A) $L_{eq\ 16\ hour}$ (free field) during the day (07.00 to 23.00 hours) or 59 dB(A) $L_{eq\ 8\ hour}$ (free field) at night (23.00 to 07.00 hours) shall be subject to sound insulation measures to ensure that **all** such rooms achieve an internal noise level of 40 dB(A) $L_{eq\ 16\ hour}$ during the day and 35 dB(A) $L_{eq\ 8\ hour}$ at night. The submitted scheme shall ensure that habitable rooms subject to sound insulation measures shall be provided with acoustically treated active ventilation units. Each ventilation unit (with air filter in position), by itself or with an integral air supply duct and cowl (or grille), shall be capable of giving variable ventilation ranges ranging from –*

- (1) *an upper rate of not less than 37 litres per second against a back pressure of 10 newtons per square metre and not less than 31 litres per second against a back pressure of 30 newtons per square metre, to*
- (2) *a lower rate of between 10 and 17 litres per second against zero back pressure.*

No habitable room shall be occupied until the approved sound insulation and ventilation measures have been installed in that room. Gardens shall be designed to provide an area which is at least 50% of the garden area for sitting out where the maximum day time noise level does not exceed 55 dB(A) $L_{eq\ 16\ hour}$ (free field).

Reason : *To ensure that the amenities of future occupiers are protected.*

(Note to Officer: Development of any part of the site, subject to noise levels in excess of 74 dB(A) $L_{eq\ 8\ hour}$ [free field] at night would not be supported. You must also be satisfied that the garden criteria can be met).

Railway Vibration

Prior to commencement of a development a scheme shall be submitted to and approved in writing by the Local Planning Authority to provide that the dwellings are designed and constructed so as to ensure that vibration dose values do not exceed 0.4m/s^{1.75} between 07.00 and 23.00 hours, and 0.26m/s^{1.75} between 23.00 and 07.00 hours, as calculated in accordance with BS 6472 : 1992, “Guide to Evaluation of Human Exposure to Vibration in Buildings (1Hz to 80Hz)”. The dwelling shall be constructed in accordance with the approved scheme.

Reason : *To ensure that the amenities of future occupiers are protected.”*

Given the results of the noise and vibration measurements, any good quality glazing will be sufficient and vibration was not detectable and is therefore not a concern.

Conclusions

The results of the noise and vibration measurements show that the site is in Category A of TAN 11 Noise, hence the site can be fully developed.



Author

S ELLIS