

SITE PREPARATION

Ground to be prepared for new works by removing all unsuitable material, vegetable matter and tree or shrub roots to a suitable depth to prevent future growth. Seal up, cap off, disconnect and remove existing redundant services as necessary. Reasonable precautions must also be taken to avoid danger to health and safety caused by contaminants and ground gases e.g. landfill gases, radon, vapours etc. on or in the ground covered, or to be covered by the building.

STRIP FOUNDATION

Provide 225mm x 550mm concrete foundation, concrete mix to conform to BS EN 206-1 and BS 8500-2. All foundations to be a minimum of 750mm below ground level, exact depth to be agreed on site with Building Control Officer to suit site conditions. All constructed in accordance with 2004 Building Regulations A1/2 and BS 8004:1986 Code of Practice for Foundations. Ensure foundations are constructed below invert level of any adjacent drains. Base of foundations supporting internal walls to be min 600mm below ground level. Sulphate resistant cement to be used if required. Please note that should any adverse soil conditions be found or any major tree roots in excavations, the Building Control Officer is to be contacted and the advice of a structural engineer should be sought.

SOLID FLOOR

To meet min U value required of 0.22 W/m²K. Solid ground floor to consist of 150mm consolidated well-rammed hardcore. Blinded with 50mm sand blinding. Provide 100mm ST2 or Gen2 ground bearing slab concrete mix to conform to BS 8500-2 over a 1200mm gauge polythene DPM. DPM to be lapped in with DPC in walls. Finish with 65mm sand/cement finishing screed with light mesh reinforcement.

EXTERNAL WALLS

20mm two coat sand/cement render to comply to BS EN 13914-1:2005 with waterproof additive on 100mm medium dense block, 215 mm piers where shown on plans, and front wall containing garage doors to be block on flat.

LINTELS

Lintel widths are to be equal to wall thickness. All lintels over 750mm sized internal door openings to be 65mm deep pre-stressed concrete plank lintels. 150mm deep lintels are to be used for 900mm sized internal door openings. Lintels to have a minimum bearing of 150mm on each end. All pre-stressed concrete lintels to be designed and manufactured in accordance with BS 8110, with a concrete strength of 50 or 40 N/mm² and incorporating steel strands to BS 5896 to support loadings assessed to BS 5977 Part 1.

For other structural openings provide proprietary insulated steel lintels suitable for spans and loadings in compliance with Approved Document A and lintel manufacturers standard tables. Stop ends, DPC trays and weep holes to be provided above all externally located lintels.


PITCHED ROOF

Pitch 25° (imposed load max 0.75 kN/m² - dead load max 0.75 kN/m²)


Natural slates to match existing on 25 x 38mm tanalised sw treated battens on sarking felt supported on preformed gangnail roof trusses spaced and braced to manufacturers specifications. trusses supported on 100 x 50mm sw wall plates. Provide opening at eaves level at least equal to continuous strip 25mm wide in two opposite sides to promote cross-ventilation. Restraint strapping - 100mm x 50mm wall plate strapped down to walls. Ceiling joists and rafters to be strapped to walls and gable walls, straps built into cavity, across at least 3 timbers with noggins. All straps to be 1000 x 30 x 5mm galvanized straps or other approved to BSEN 845-1 at 2m centres

ELECTRICAL


All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a competent person registered under a competent person self certification scheme such as BRE certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a certificate will be given to Building Control on completion.

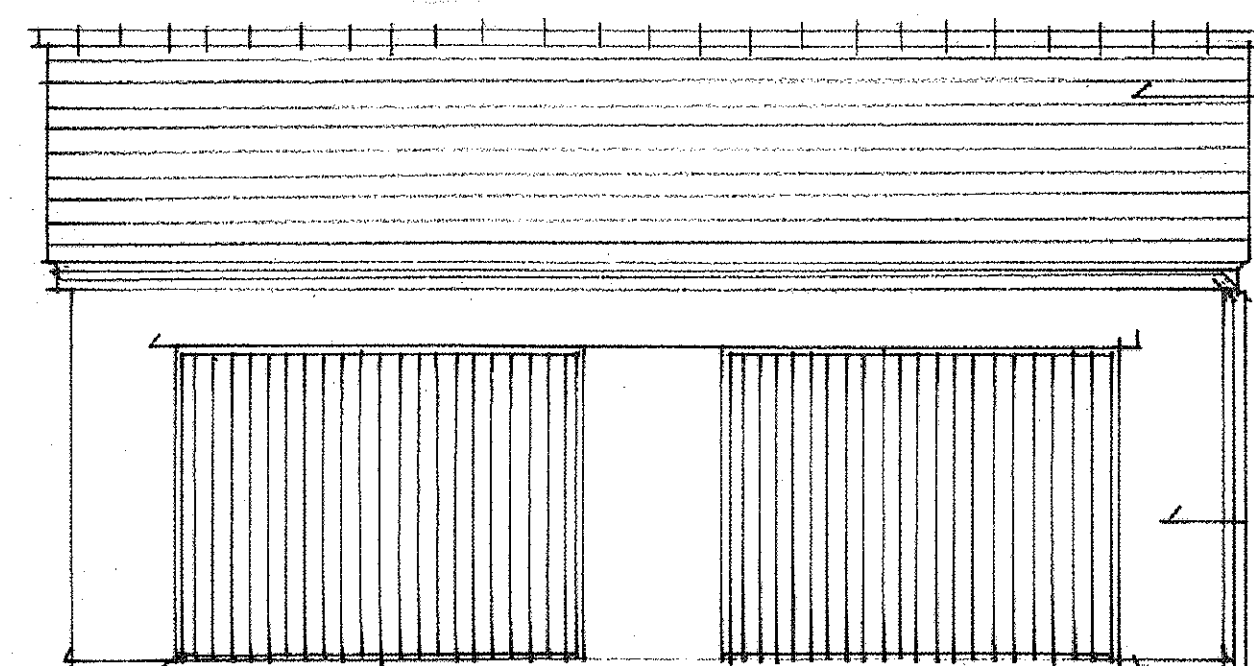

FRONT

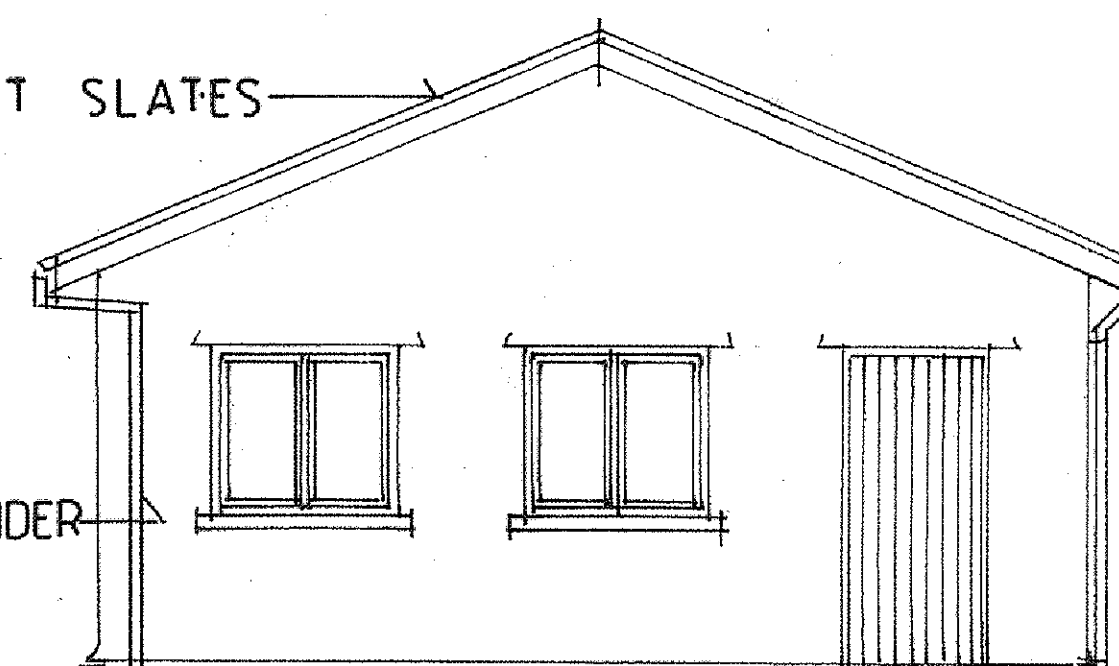

SIDE

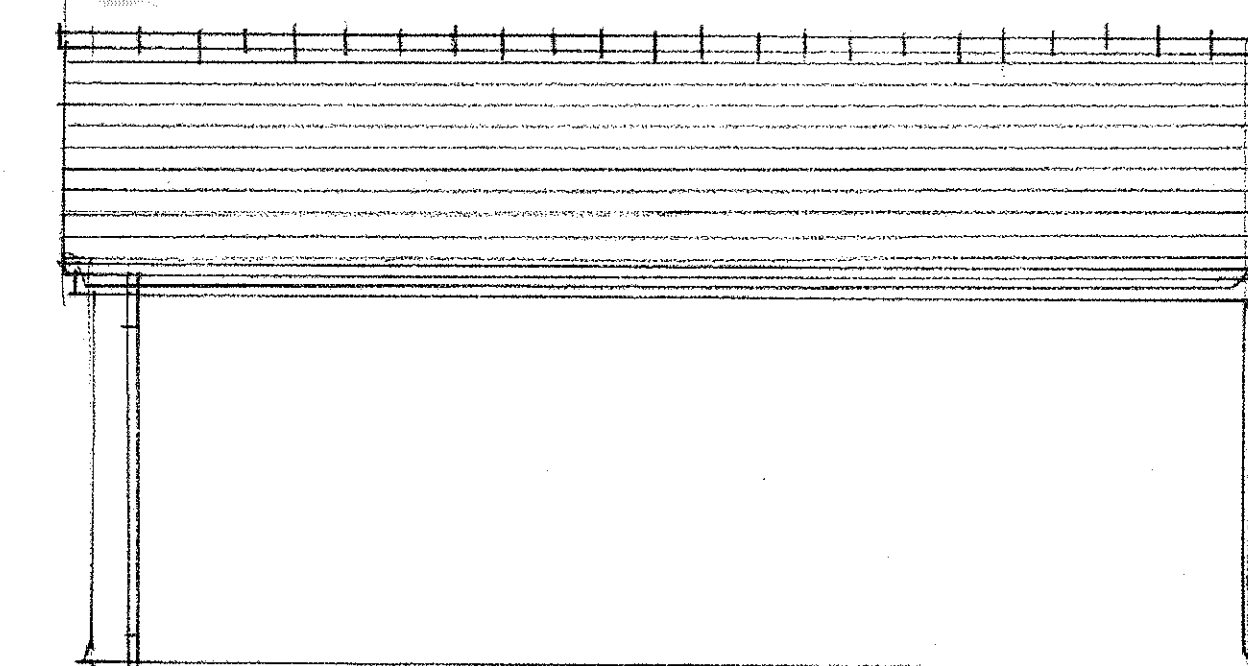

REAR

NEW WINDOWS

New and replacement windows to be double glazed with 16mm argon gap and soft coat low-E glass. Window Energy Rating to be Band C or better and to achieve U-value of 1.6 W/m²K. The door and window openings should be limited to 25% of the extension floor area plus the area of any existing openings covered by the extension.

NEW DOORS

New and replacement doors to achieve a U-Value of 1.80W/m²K. Glazed areas to be double glazed with 16mm argon gap and soft low-E glass. Glass to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1:2011 and Part K (Part N in Wales) of the current Building Regulations.

RAINFATER DRAINAGE

New rainwater goods to be new 110mm UPVC half round gutters taken and connected into 68mm dia UPVC downpipes. Rainwater taken to new soakaway, situated a min distance of 5.0m away from any building, via 110mm dia UPVC pipes surrounded in 150mm granular fill. Soakaway to be min of 1 cubic metre capacity (or to depth to Local Authorities approval) with suitable granular fill and with geotextile surround to prevent migration of fines. If necessary carry out a porosity test to determine design and depth of soakaway.

RECEIVED

21 AUG 2014

ENVIRONMENTAL
AND ECONOMIC
REGENERATION

14 00988 FUL

Amendments:		Rev:
JOB TITLE:		
PROPOSED SINGLE STOREY GARAGE TO REPLACE GARAGE AND HOBBY ROOM AS APPROVED REF: 2013/00801/FUL INCLUDING NEW AMENDMENTS TO MAIN HOUSE AS APPROVED		
DRAWING TITLE:		
PROPOSED GARAGE		
SCALES:	DRAWN BY:	DRAWING NUMBER:
1: 125 @ A1	PH	556/P/34
1:250 @ A3		
DATE: JUNE 2014		
ANDREW PARKER ASSOCIATES ARCHITECTS, LANDSCAPE AND DESIGN CONSULTANTS		
THE GREAT BARN, BONVILSTON, VALE OF GLAMORGAN, CARDIFF, WALES CF5 6TR Tel / Fax: (01446) 781185 Email: andrew@greatbarn.com		
THESE DRAWINGS MAY BE SCALED FOR PLANNING PURPOSES ONLY DO NOT SCALE FROM THIS DRAWING FOR CONSTRUCTION PURPOSES ALL DIMENSIONS TO BE CHECKED ON SITE ARCHITECT TO BE NOTIFIED OF ANY DISCREPANCIES IN DIMENSIONS ALL WORK TO CURRENT BUILDING REGULATION STANDARDS THIS DRAWING IS COPYRIGHT		