



SIDE ELEVATION Scale 1:50

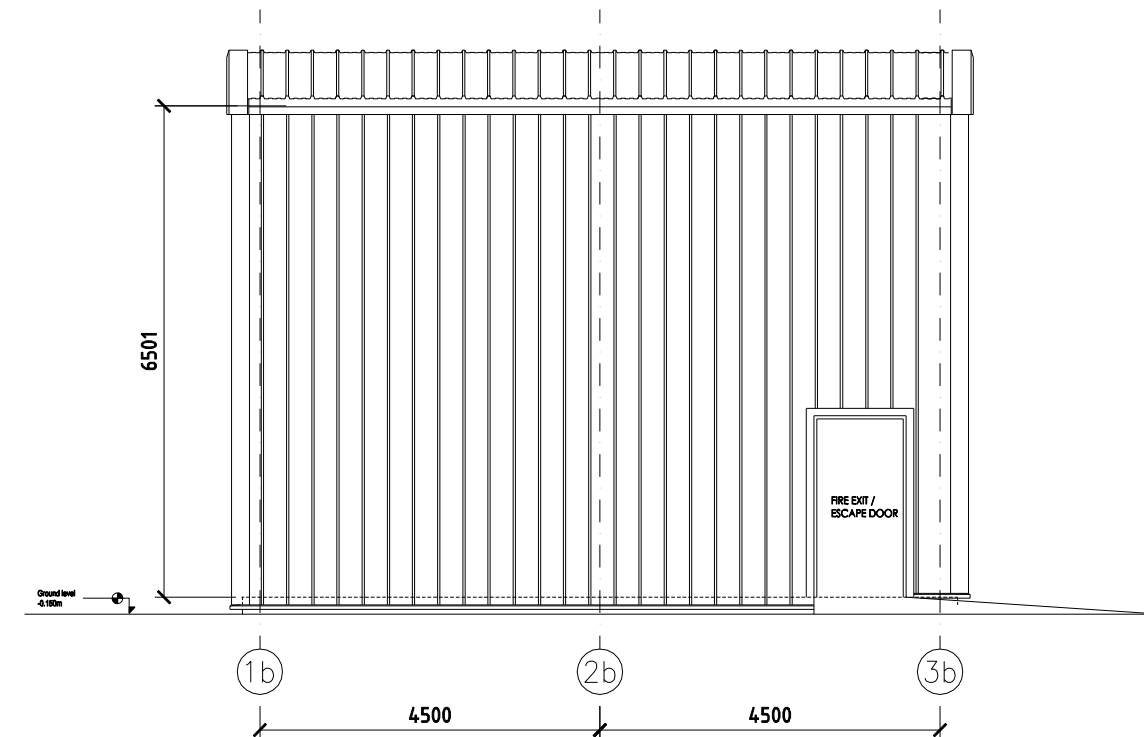

REAR ELEVATION Scale 1:50

THE VALE OF GLAMORGAN COUNCIL  
**SUPERSEDED**

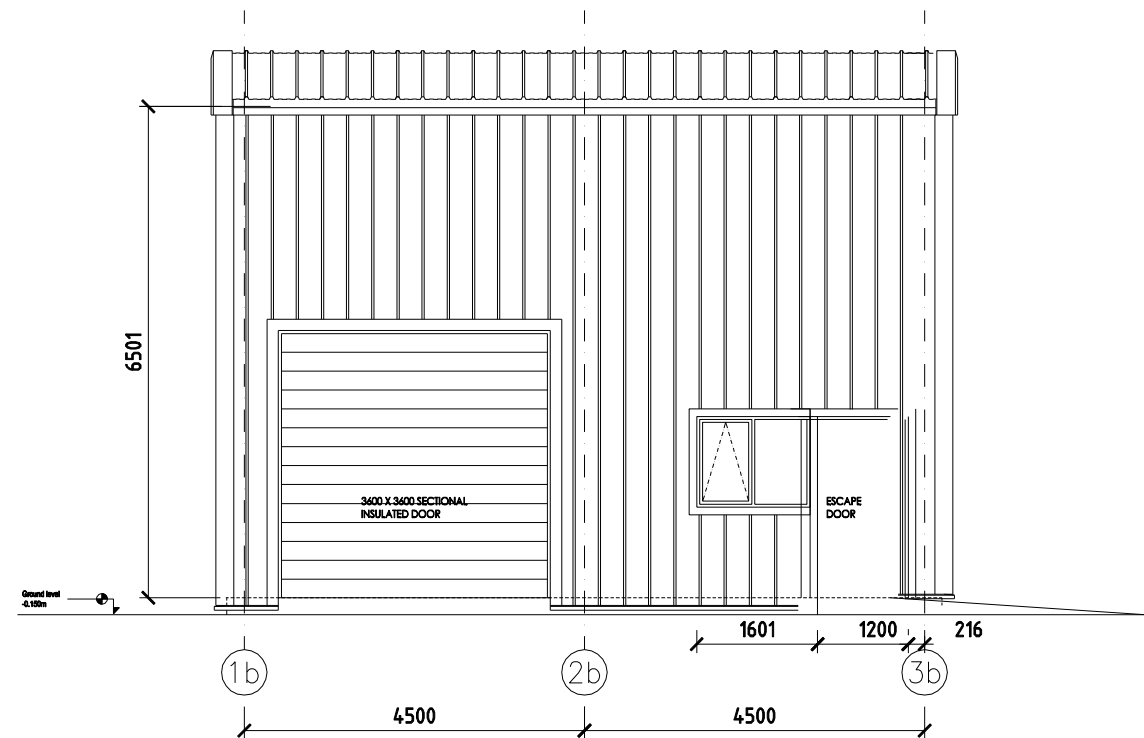

FRONT ELEVATION Scale 1:50

**FOUNDATIONS**  
1200 x 1200 x 750mm deep mass concrete pad foundations to each stanchion - all to Structural Engineer's specification and design  
Gable steel and foundations offset 16mm inwards

**STRUCTURE**  
Gable Stanchions:  
254 x 146 x 31 UB set on base plate 300 x 350 x 15 with 22Ø holes with  
4 No M20x300 HD bolts  
Main (Intermediate) Stanchions:  
305 x 165 x 40 UB set on base plate 300 x 300 x 15 with 22Ø holes with  
4 No M20x300 HD bolts  
Structure to incorporate Rafter stays and ridge gusset plates as indicated

**FLOOR CONSTRUCTION**  
175mm min thick concrete slab with 1 layer A193 reinforcement laid on 100mm oversite insulation - Kingspan Thermofloor 1F70 or equal approved on 1200 gauge oversite DPM on 50mm min sand bedding on 150mm minimum hardcore Slab to thicken to 450mm minimum beneath perimeter wall  
Dimensions to be confirmed by Structural engineer and to provide a minimum U-Value of 0.25W/m<sup>2</sup>.K

**ROOF CLADDING**  
100mm Kingspan K31000RW to provide a minimum U-Value of 0.25W/m<sup>2</sup>.K Cladding laid on purlins (Abalon Z14615 sleeved rail system or equal approved)

**WALL CLADDING**  
800mm Kingspan K31000RW to provide a minimum U-Value of 0.35W/m<sup>2</sup>.K Cladding fixed to (Abalon Z14615 sleeved sheathing rail system or equal approved)

**WINDOWS/DOORS**  
UPVC thermally broken double glazed with 16mm minimum air gap (Low E, E<sub>n</sub> = 0.2) to provide a minimum U-Value of 2.2 W/m<sup>2</sup>.K  
Glazed and part glazed doors to be fitted with laminate toughened glass to comply with BS 6206 / 1981  
Main entrance doorway to incorporate level threshold

**SERVICE DOORS**  
3.6m high x 3.6m wide Sectional Insulated doors to provide a minimum U-Value of 1.5 W/m<sup>2</sup>.K

**FLASHINGS/SEALS**  
All flashings to be as per Kingspan standard detail sheets and in compliance with current Building Regulations  
All seals to be as per Kingspan standard detail sheets and in compliance with current Building Regulations

**STORM WATER DRAINAGE**  
0.7mm thick PM Gutter double sided plastisol coated as Kingspan standard details with all necessary support brackets to discharge via 4 No 100mm Ø aluminium downpipes to trapped gutleys to connect to 150mm Ø PVC drains laid to minimum falls 1 in 40 to existing (site) surface water drainage system  
Pipes to be surrounded in pea gravel or weak mk concrete where subjected to vehicular traffic

**FOUL DRAINAGE**  
100mm Ø UPVC foul drains laid to minimum falls 1 in 40 to connect into existing (site) foul drainage  
Pre-cast concrete inspection chambers with heavy duty galvanised steel double seal covers with strong mortar benching, slow bends  
SVP as noted 100mm Ø UPVC with laid proof vent at top terminating minimum 750mm above eaves line  
Waste(s) to handbasin(s) to be 38mm with 75mm Ø bottle traps via back inlet gutleys  
Waste(s) to sink(s) to be 40mm with 75mm Ø bottle traps via back inlet gutleys  
Wastes to WCs to be 100mm Ø - All in UPVC

**DISABLED ACCESS WC**  
To comply with Diagram 18 Section M1 / M3 of current building Regulations/inlet gutleys

**INTERNAL WALLS**  
100mm thick medium density block walls finished fairfaced to receive decoration by others

**PERIMETER WALLS**  
225mm high x 100mm thick medium density block walls finished fairfaced to receive decoration by others with 20mm thick natural finish Vermiculux board countersunk and predrilled and plugged and screwed to top of block wall to seal cavity - Junction with cladding sealed using two part polysulfide mastic  
Blockwork built off DPC on RC slab and lapped over over-site DPM  
Blockwork tied back to structural steel using ANCON PP8 S/S sliding anchors complete with de-bonding sleeves 125mm long drilled to columns using 6mm Ø weld tapping screws or similar approved all at 750mm centres vertically

**WATER HEATING**  
Each hand basin to have individual instantaneous electric hot water supply

**VENTILATION TO WC**  
To have mechanical extract fans providing minimum 4l/s per WC per hour electrically linked to light switch with 20 minute over-run

**HEATING**  
Gas or oil fired hot air heating system installed by specialist contractor with certification to comply with requirements of current A doc Part J and Part M

**SMOKE DETECTION / FIRE ALARMS**  
Smoke detection, position of automatic fire detection and alarm systems to comply with BS 5839-1 2013

**DISABLED ACCESS**  
Internal doors to be 1/2 hour fire rated doors complete with smoke seals, self closers and vision panels to comply with Current A Doc Part B

**FIRE RATING**  
Internal doors to be 1/2 hour fire rated doors complete with smoke seals, self closers and vision panels to comply with Current A Doc Part B

**FIRE EXITS**  
Fire exits to exterior grade doors and frames fitted with panic latches over-riding any locking devices  
Fire exit signs to comply with BS 5499-4 2000 (Health and Safety signs and Signs)

**EMERGENCY LIGHTING**  
Positions of emergency lighting to comply with BS 5266.1 2011

**STRUCTURAL DETAILS AND CALCULATIONS**  
For details and calculations refer to design sheets 1-31 Ref Windmill Estate, Barry

This drawing to be read in conjunction with all specifications and all other consultants design information. Any contradictions between this drawing and any other design information to be advised to the contract administrator and author immediately

The contractor to site measure, check and verify all information issued, and confirm the correctness of the contents prior to the commencement on site.

The contractor to comply with all current statutory legislation, Building Regulations, British Standards, and good building practice.

Do not scale from this drawing.

Mitigation Measures as recommended by Sanderson Associates (Consulting engineers) Ltd's report dated 13 November 2014

Any proposed development that has the potential to change the flood mechanisms on a site is to be designed such that there is no increased flood risk to the site itself, or sites upstream and downstream of the development. Any critical plant or water sensitive stored goods within the site should be raised to a minimum of 600mm above the finished floor level of the proposed units where practicable to do so.

The floor slab of the unit and internal walls up to 600mm above slab level should be sealed with a treatment that will prevent the leaching of flood waters. This will assist in the cleaning of the units should a flood event occur.

Drains within the limits of the site should be regularly inspected and cleared wherever necessary to reduce the risk of blockages and subsequent flooding.

A flood evacuation plan should be provided for the site staff. The flood evacuation plan should include the following information for the current occupiers and must be passed onto any subsequent occupiers to ensure continuity as far as is practicably possible:

- How to register for 'Flood Warnings Direct', a free NRW service which provides flood warnings to each registered member by selected media such as telephone, email, text message which is tailored to each registered members requirements.

- What the different flood codes mean for the property when issued by the NRW (Natural Resources Wales) and what actions to take.

- Confirmation on what the sources of flood risk are to the property

- Confirmation of escape routes from the site should evacuation be attempted

- Advice on what to include in the flood kit

- Useful contact numbers if required.

Client: Windmill Property Development

Units 11 and 12

Title: UNIT 11 - PROPOSED ELEVATIONS

Scale: 1 : 50 @ A1

Date: April 2014

Drawing No: A 008

Revision: A

© the drawing, design and the building works depicted are the copyright of Windmill Property Development Ltd & may not be reproduced or amended, except by the written permission of Windmill Property Development Ltd. No liability will be accepted for any amendments made by other persons.  
The issue of this drawing/document does not confer any license for use of the design to any party whatsoever save as expressly agreed by Windmill Property Development Ltd.