Ordnance Survey base mapping supplied by Welsh Government 2016, © Crown copyright and database rights [2016] Ordnance Survey

ISO A1 594mm x 841mm

Project Management Initials: Designer: AB Checked: TM Approved: RM

NOTES

1. ALL WORKS ARE TO BE CARRIED OUT IN ACCORDANCE WITH THE CONTRACT SPECIFICATION AND THE MANUAL OF CONTRACT DOCUMENTS FOR HIGHWAY WORKS.

2. ALL WORKING HOURS AND TRAFFIC MANAGEMENT MEASURES ARE TO BE AGREED WITH THE LOCAL HIGHWAY AUTHORITY AND DEPLOYED IN ACCORDANCE WITH CHAPTER 8 OF THE TRAFFIC SIGNS MANUAL.

3 LOCATION OF SITE COMPOUND TO BE AGREED WITH THE LOCAL HIGHWAY AUTHORITY PRIOR TO WORKS COMMENCING. ALL MOVEMENT OF PLANT SHOULD BE IN ACCORDANCE WITH RECOGNISED GOOD INDUSTRY PRACTICE. BANKSMEN SHOULD BE PROVIDED WHEN REQUIRED.

4. THE GENERAL PUBLIC SHOULD BE SEPARATED FROM THE WORKS WITH ADEQUATE LATERAL CLEARANCE AND APPROPRIATE SAFETY ZONES PROVIDED IN ACCORDANCE WITH CHAPTER 8 OF THE TRAFFIC SIGNS MANUAL.

5. ACCESS TO PRIVATE PROPERTIES MUST BE MAINTAINED AT ALL TIMES UNLESS OTHERWISE AGREED WITH THE AFFECTED PARTY AND THE LOCAL HIGHWAY AUTHORITY.

6. MEASURES SHOULD BE DEPLOYED TO ENSURE NOISE, VIBRATION AND DUST IS MINIMISED.

7. ALL BURIED SERVICES ARE TO BE POSITIVELY LOCATED ON SITE PRIOR TO EXCAVATION. CAT SCANS SHALL BE COMPLETED PRIOR TO EXCAVATION WITH SERVICE LOCATIONS MARKED UP ON SITE. OPERATIVES SHALL EMPLOY HAND DIGGING METHODS WHEN WORKING IN CLOSE PROXIMITY TO BURIED SERVICES. STATUTORY UNDERTAKER'S PLANT SHALL BE PROTECTED AS NECESSARY. ADDITIONAL TRIAL PITS SHALL BE EXCAVATED AS REQUIRED.

9.THIS DRAWING IS BASED UPON INFORMATION SUPPLIED BY THE STATURORY UNDERTAKERS, THE ACCURACY OF WHICH CANNOT BE GUARANTEED.

KEY

ELECTRIC	OVERHEAD CABLE UNKNOWN
RAF	RAF OWNED DUCT UNKNOWN
WESTERN POWER	WESTERN POWER LOW VOLTAGE UNDERGROUND
WESTERN POWER	WESTERN POWER SERVICE UNDERGROUND
WESTERN POWER	WESTERN POWER 11KV UNDERGROUND
WESTERN POWER	WESTERN POWER PL UNDERGROUND
WESTERN POWER	WESTERN POWER 66KV UNDERGROUND
WESTERN POWER	WESTERN POWER 66KV OVERHEAD
WESTERN POWER	WESTERN POWER 132KV OVERHEAD
GAS	WALES AND WEST UNDERGROUND HIGH PRESSURE
GAS	WALES AND WEST UNDERGROUND MEDIUM PRESSURE
GAS	WALES AND WEST UNDERGROUND LOW PRESSURE
BT	BT DUCT
BT	BT UNDERGROUND
BT	BT OVERHEAD
WATER	FOUL SEWER
WATER	TRUNK SEWER
WATER	SURFACE WATER SEWER
WATER	DISTRIBUTION SEWER
VIRGIN	VIRGIN CABLE
	PLANNING BOUNDARY

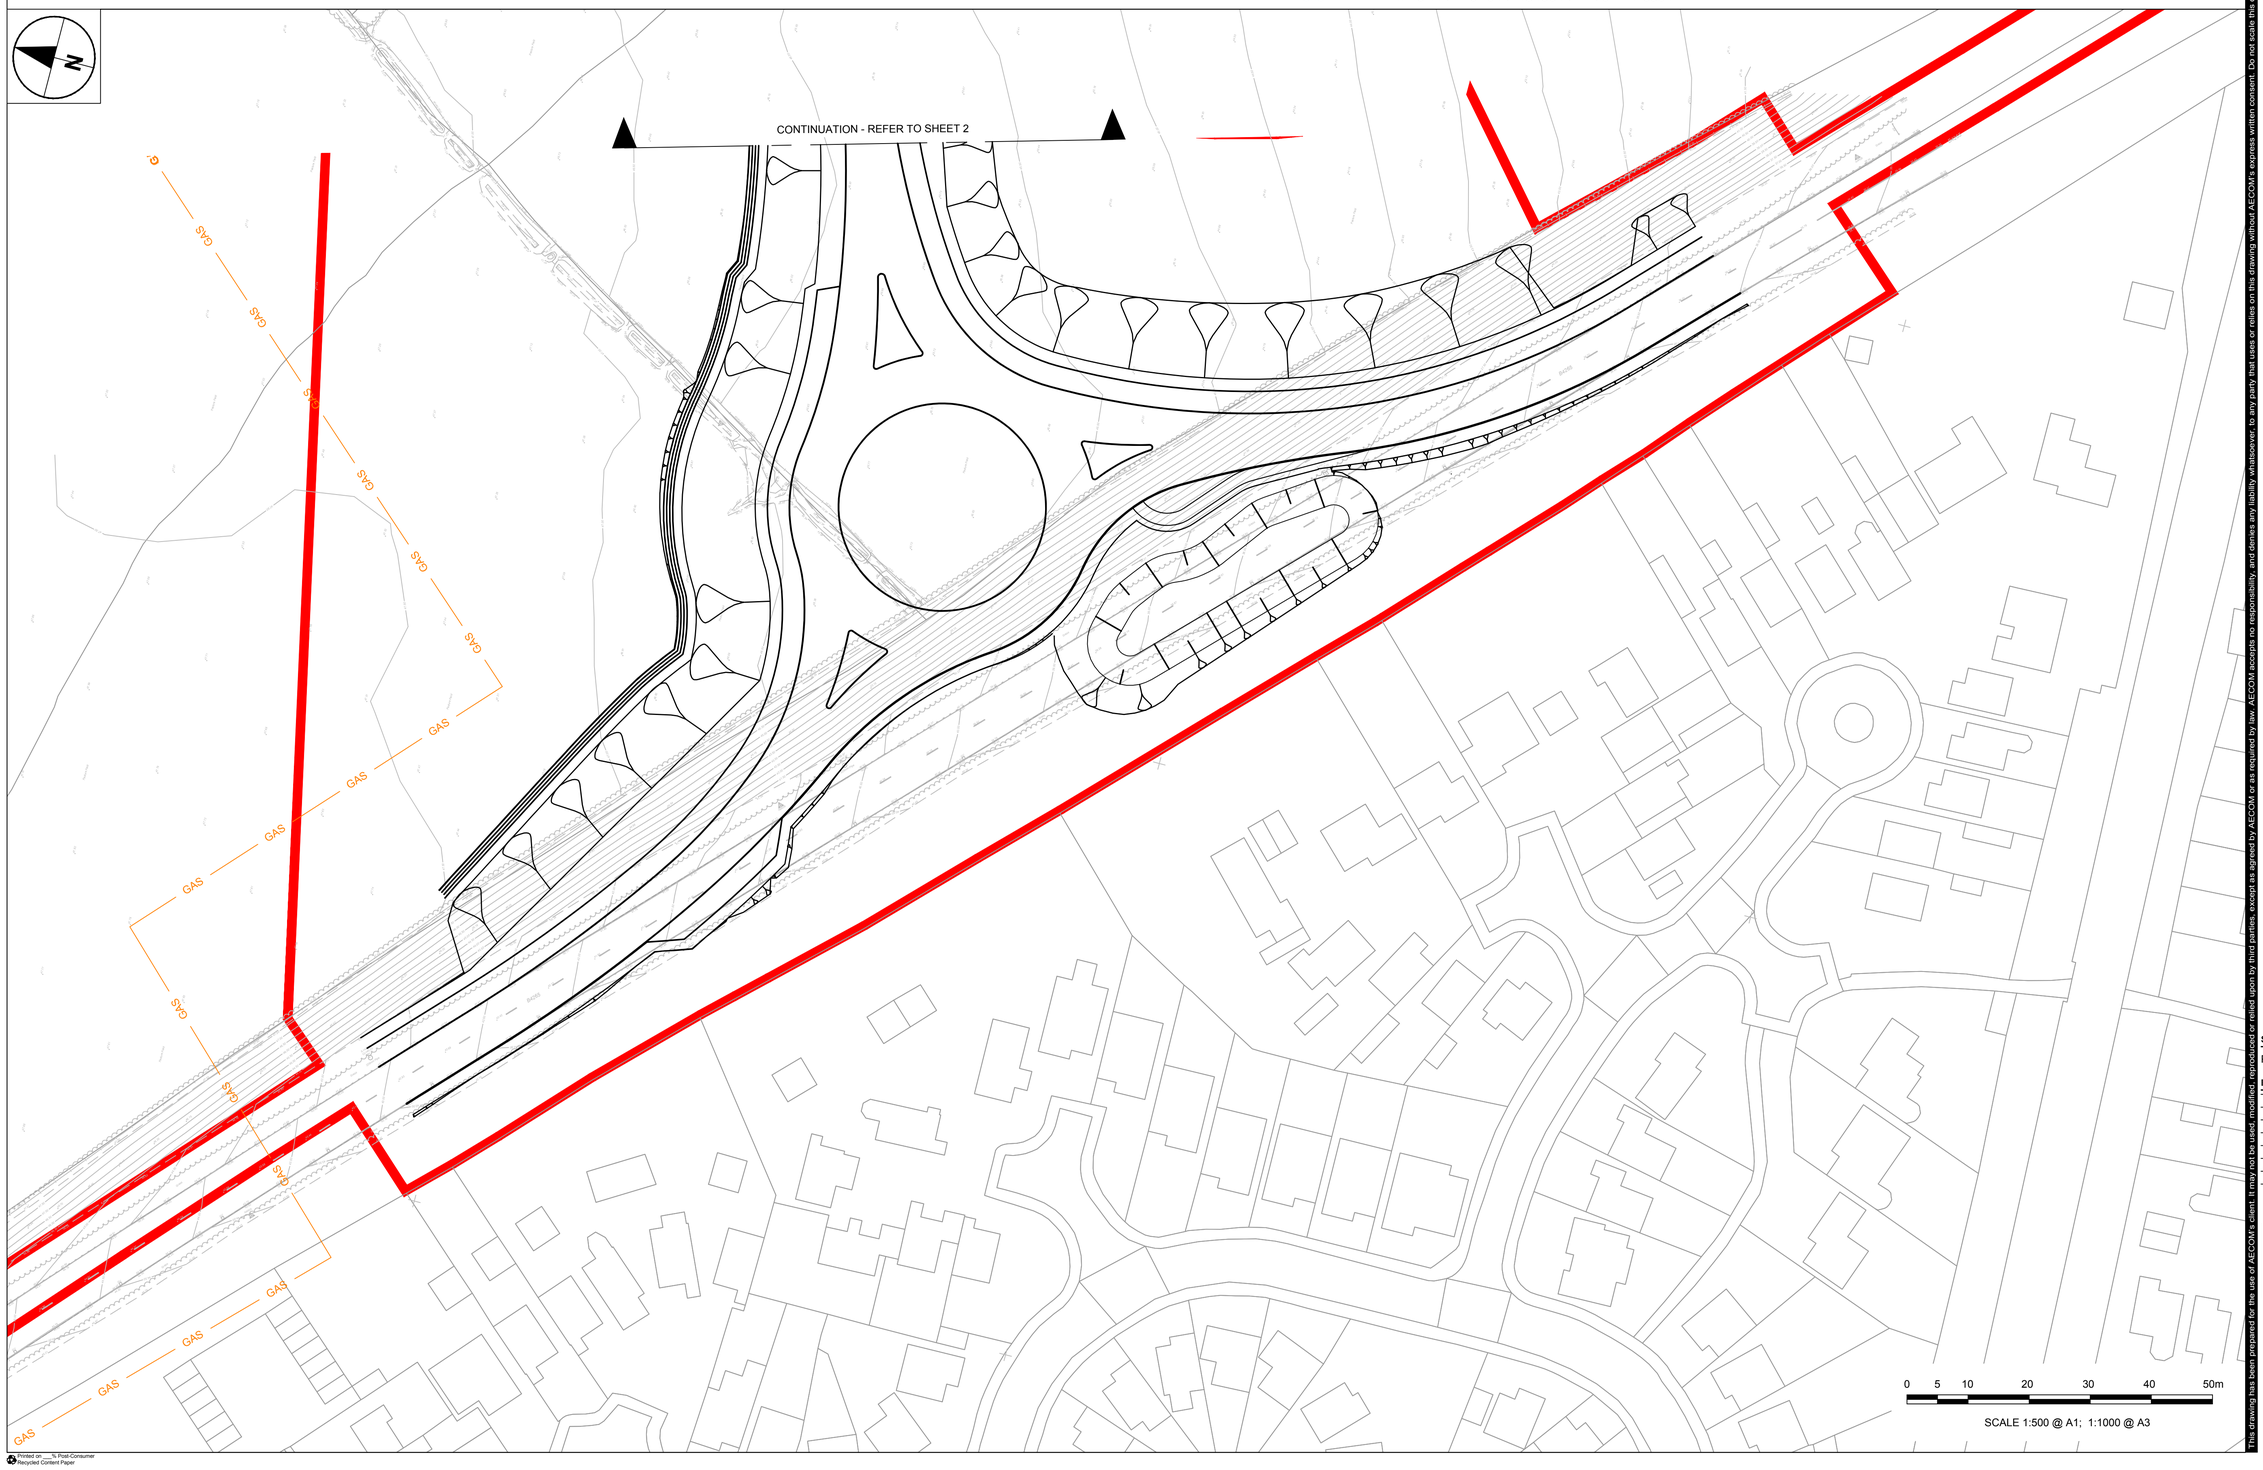

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT

ST. ATHAN NORTHERN ACCESS ROAD

CLIENT

WELSH GOVERNMENT

Llywodraeth Cymru
Welsh Government

CONSULTANT

AECOM
1 CALLAGHAN SQUARE
CARDIFF
CF10 5BT
TEL: (029) 20674600
FAX: (029) 20674699

SAFETY, HEALTH AND ENVIRONMENTAL INFORMATION
In addition to the hazards/risks normally associated with the types of work detailed on this drawing, note the following specific residual risks (Reference shall also be made to the design hazard log).
Construction
WORKING ON AND ADJACENT TO LIVE CARRIAGEWAY
LIVESTOCK IN ADJACENT LAND
DEEP CUTTING IN THIS AREA, STABILITY OF GROUND COULD BE AFFECTED

STATUS

PLANNING SUBMISSION ISSUE

ISSUE/REVISION

I/R	DATE	DESCRIPTION
A	27-03-2017	PLANNING SUBMISSION ISSUE

KEY PLAN



PROJECT NUMBER

60509148

SHEET TITLE

ST.ATHAN
EXISTING UTILITIES
SHEET 1 OF 7

SHEET NUMBER

60509148-SHT-30-0000-CT-0551

Filename: P:\UKCDP1-1\PPROJECTS\HIGHWAYS - ST ATHAN\03 EXECUTION\03 DOCUMENTS\08 CAD\01 WORKING\DRAWINGS\0550 - UTILITIES PLANS\60509148-SHT-30-0000-CT-0551_0557.DWG Last saved by: CASSIDYD Last Plotted: 2017-05-25

Printed on ___% Post-Consumer Recycled Content Paper