


ISO A1 594mm x 841mm  
 Project Management Initials: Designer: ES/DT Checked: RM Approved:  
 File name: F:\PROJECTS\HIGHWAYS - ST. ATHAN\03\_EXECUTION\03\_DOCUMENTS\08 CAD\01\_WORKING\DRAWINGS\0600 - EARTHWORKS\GI PLANNING\60509148-SHT-20-0001-CT-0101-GI PLANNING - PROPOSED.DWG Last saved by: TAYLORD12 Last Plotted: 2016-09-09

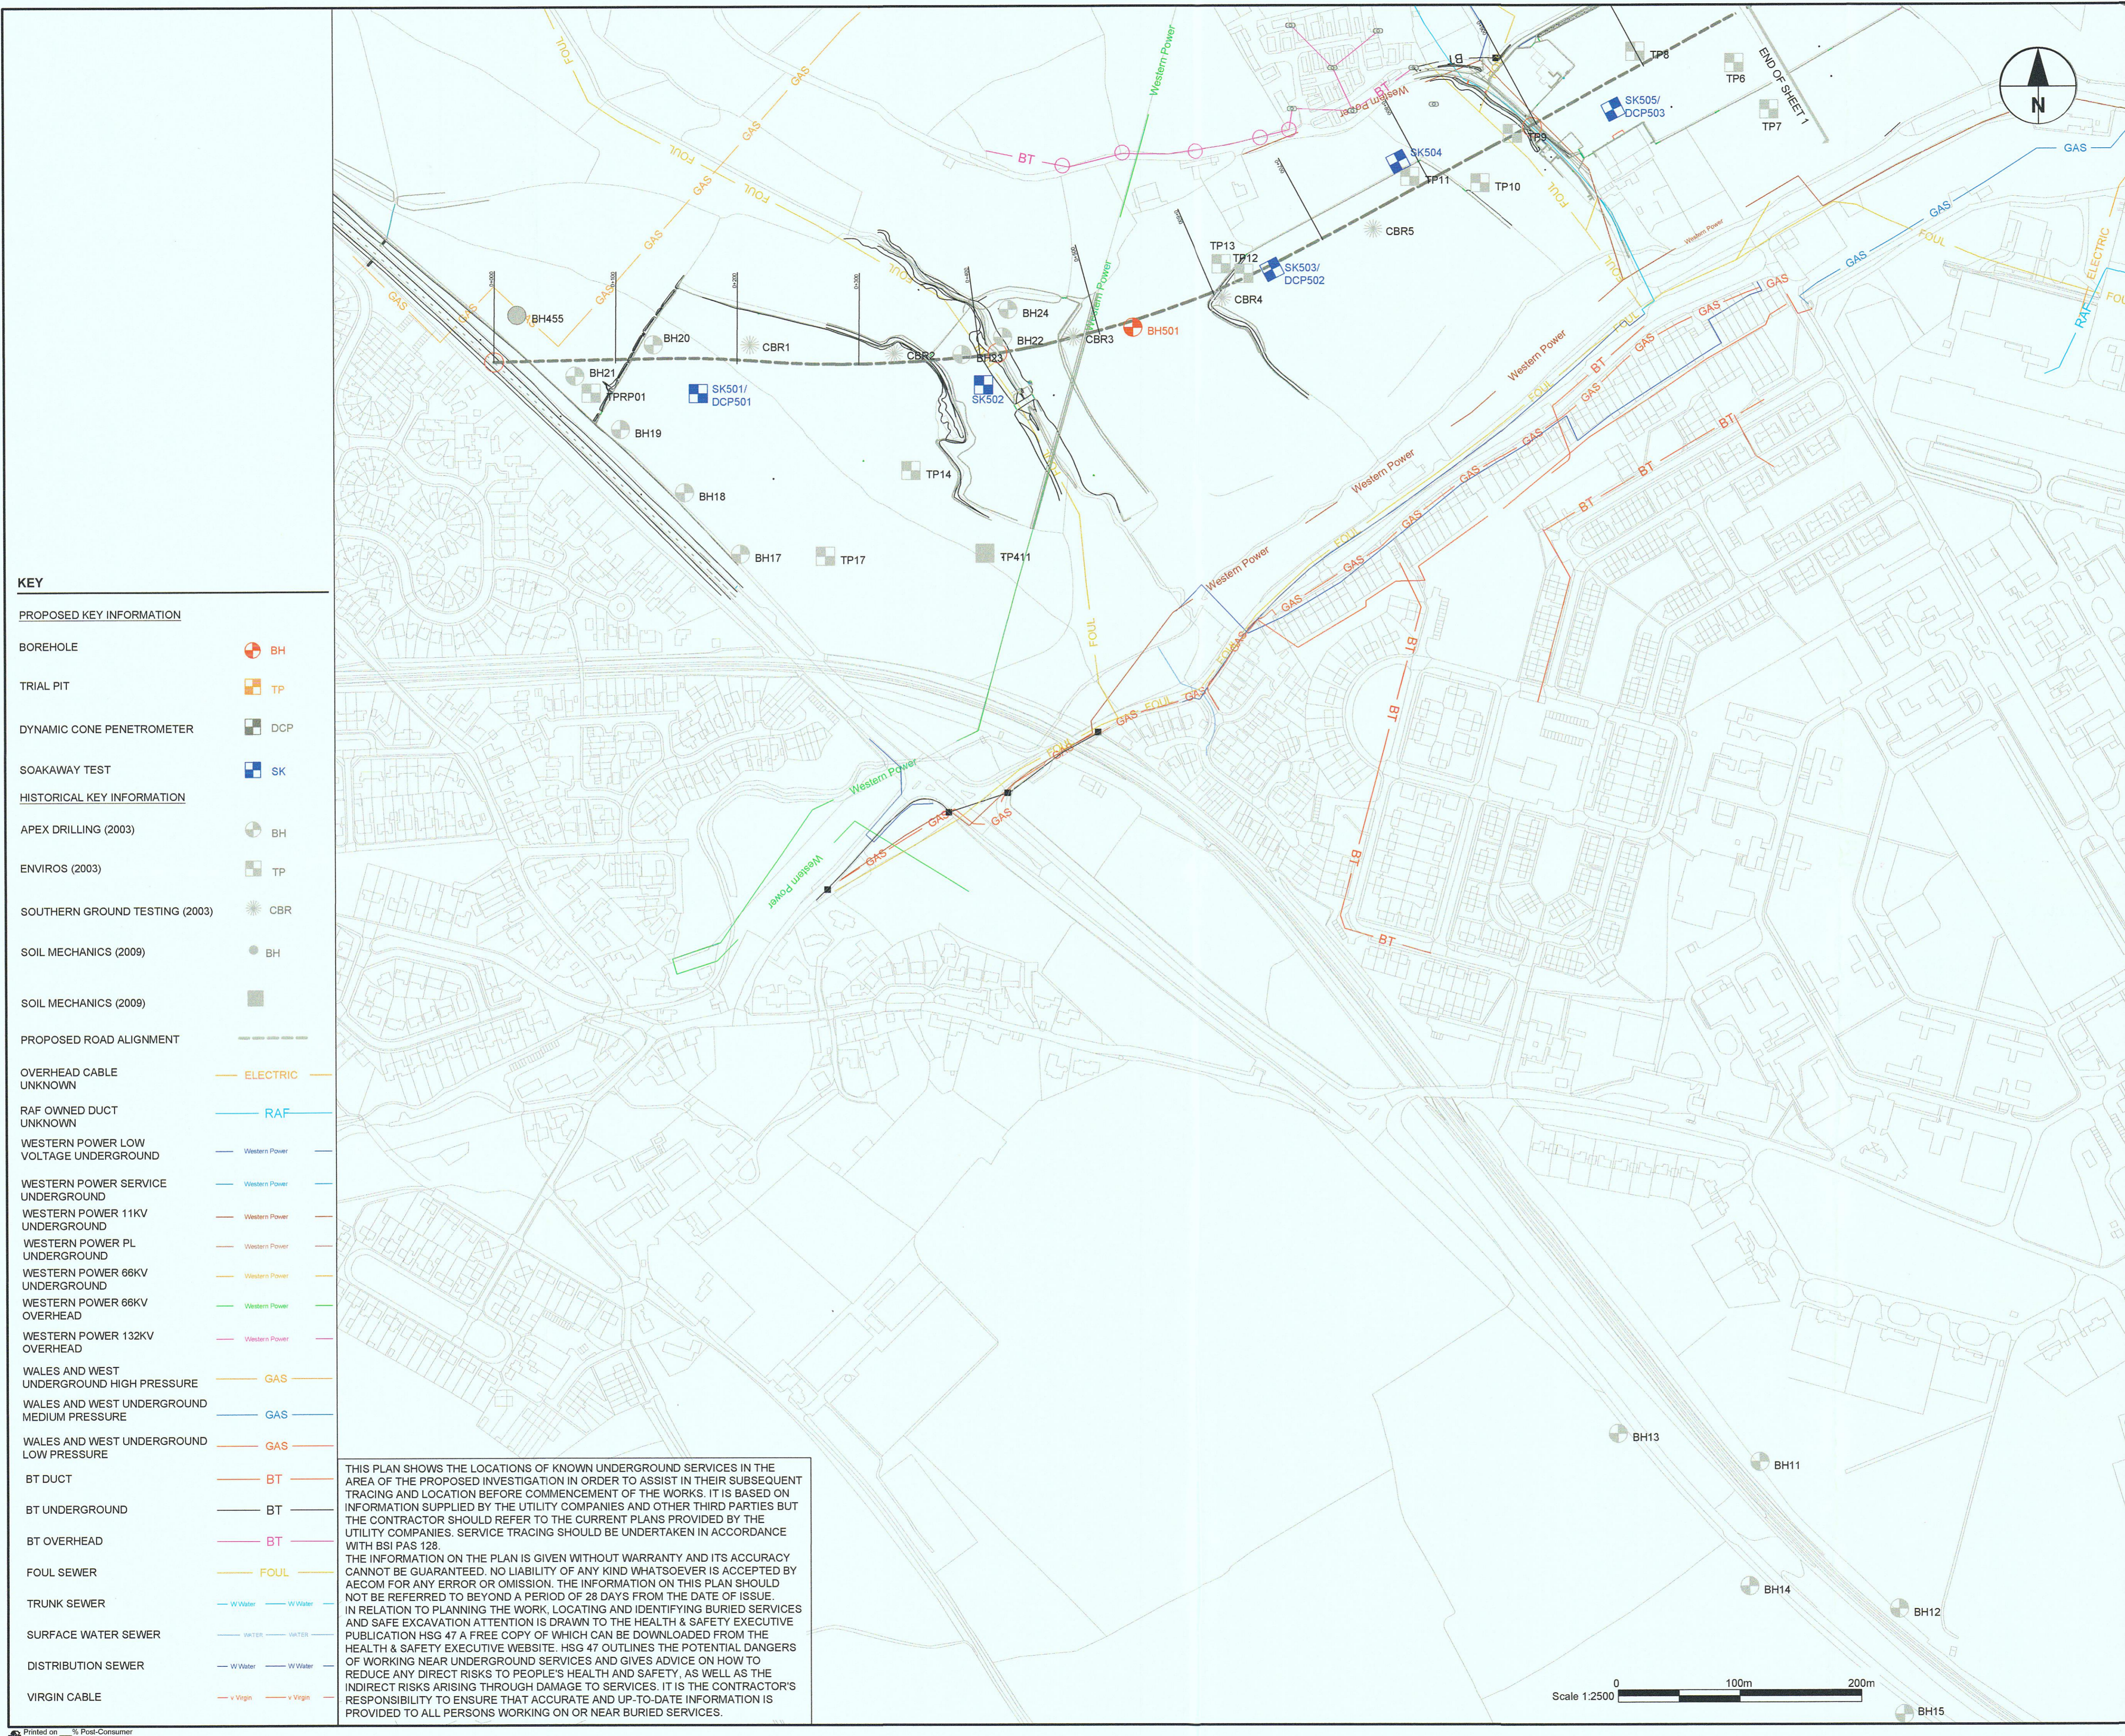


**KEY**

PROPOSED KEY INFORMATION	
BOREHOLE	BH
TRIAL PIT	TP
DYNAMIC CONE PENETROMETER	DCP
SOAKAWAY TEST	SK
HISTORICAL KEY INFORMATION	
APEX DRILLING (2003)	BH
ENVIROS (2003)	TP
SOUTHERN GROUND TESTING (2003)	CBR
SOIL MECHANICS (2009)	BH
SOIL MECHANICS (2009)	TP
PROPOSED ROAD ALIGNMENT	---
OVERHEAD CABLE UNKNOWN	ELECTRIC
RAF OWNED DUCT UNKNOWN	RAF
WESTERN POWER LOW VOLTAGE UNDERGROUND	Western Power
WESTERN POWER SERVICE UNDERGROUND	Western Power
WESTERN POWER 11KV UNDERGROUND	Western Power
WESTERN POWER PL UNDERGROUND	Western Power
WESTERN POWER 66KV UNDERGROUND	Western Power
WESTERN POWER 66KV OVERHEAD	Western Power
WESTERN POWER 132KV OVERHEAD	Western Power
WALES AND WEST UNDERGROUND HIGH PRESSURE	GAS
WALES AND WEST UNDERGROUND MEDIUM PRESSURE	GAS
WALES AND WEST UNDERGROUND LOW PRESSURE	GAS
BT DUCT	BT
BT UNDERGROUND	BT
BT OVERHEAD	BT
FOUL SEWER	FOUL
TRUNK SEWER	W Water
SURFACE WATER SEWER	Water
DISTRIBUTION SEWER	W Water
VIRGIN CABLE	v Virgin

THIS PLAN SHOWS THE LOCATIONS OF KNOWN UNDERGROUND SERVICES IN THE AREA OF THE PROPOSED INVESTIGATION IN ORDER TO ASSIST IN THEIR SUBSEQUENT TRACING AND LOCATION BEFORE COMMENCEMENT OF THE WORKS. IT IS BASED ON INFORMATION SUPPLIED BY THE UTILITY COMPANIES AND OTHER THIRD PARTIES BUT THE CONTRACTOR SHOULD REFER TO THE CURRENT PLANS PROVIDED BY THE UTILITY COMPANIES. SERVICE TRACING SHOULD BE UNDERTAKEN IN ACCORDANCE WITH BSI PAS 128.

THE INFORMATION ON THE PLAN IS GIVEN WITHOUT WARRANTY AND ITS ACCURACY CANNOT BE GUARANTEED. NO LIABILITY OF ANY KIND WHATSOEVER IS ACCEPTED BY AECOM FOR ANY ERROR OR OMISSION. THE INFORMATION ON THIS PLAN SHOULD NOT BE REFERRED TO BEYOND A PERIOD OF 28 DAYS FROM THE DATE OF ISSUE. IN RELATION TO PLANNING THE WORK, LOCATING AND IDENTIFYING BURIED SERVICES AND SAFE EXCAVATION ATTENTION IS DRAWN TO THE HEALTH & SAFETY EXECUTIVE PUBLICATION HSG 47 A FREE COPY OF WHICH CAN BE DOWNLOADED FROM THE HEALTH & SAFETY EXECUTIVE WEBSITE. HSG 47 OUTLINES THE POTENTIAL DANGERS OF WORKING NEAR UNDERGROUND SERVICES AND GIVES ADVICE ON HOW TO REDUCE ANY DIRECT RISKS TO PEOPLE'S HEALTH AND SAFETY, AS WELL AS THE INDIRECT RISKS ARISING THROUGH DAMAGE TO SERVICES. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT ACCURATE AND UP-TO-DATE INFORMATION IS PROVIDED TO ALL PERSONS WORKING ON OR NEAR BURIED SERVICES.



**AECOM**

PROJECT  
**ST. ATHAN  
 NORTHERN ACCESS  
 ROAD**

CLIENT  
**WELSH GOVERNMENT**

Llywodraeth Cymru  
 Welsh Government

CONSULTANT  
 AECOM  
 1 CALLAGHAN SQUARE  
 CARDIFF  
 CF10 5BT  
 TEL: (029) 20674600 FAX: (029) 20674699

NOTES

RECEIVED  
 - 7 JUN 2017  
 Regeneration  
 and Planning

**DRAFT**

**SAFETY, HEALTH AND ENVIRONMENTAL INFORMATION**

In addition to the hazards/risks normally associated with the types of work detailed on this drawing, note the following specific residual risks (Reference shall also be made to the design hazard log).

Construction  
 For Hazards Refer to Document: Safety in Design - Designers Residual Hazard Register

17 005 64 FUL

ISSUE/REVISION

A	DATE	DESCRIPTION
A	09-09-2016	FOR APPROVAL

**KEY PLAN**

**PROJECT NUMBER**  
 60509148

**SHEET TITLE**  
 ST ATHAN  
 PROPOSED GROUND INVESTIGATION  
 LOCATIONS  
 SHEET 1 OF 2

**SHEET NUMBER**  
 60509148-SHT-30-0000-CT-0652

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.