

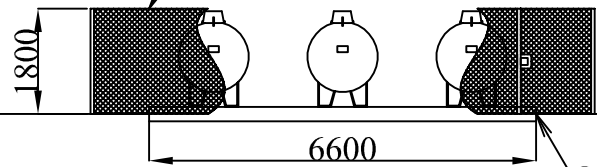


| | |
|----------|--|
| Revision | |
| Comments | |

Compound fence, to be constructed of mesh, palisade or similar with 2no outwards opening gates on non-adjacent sides.

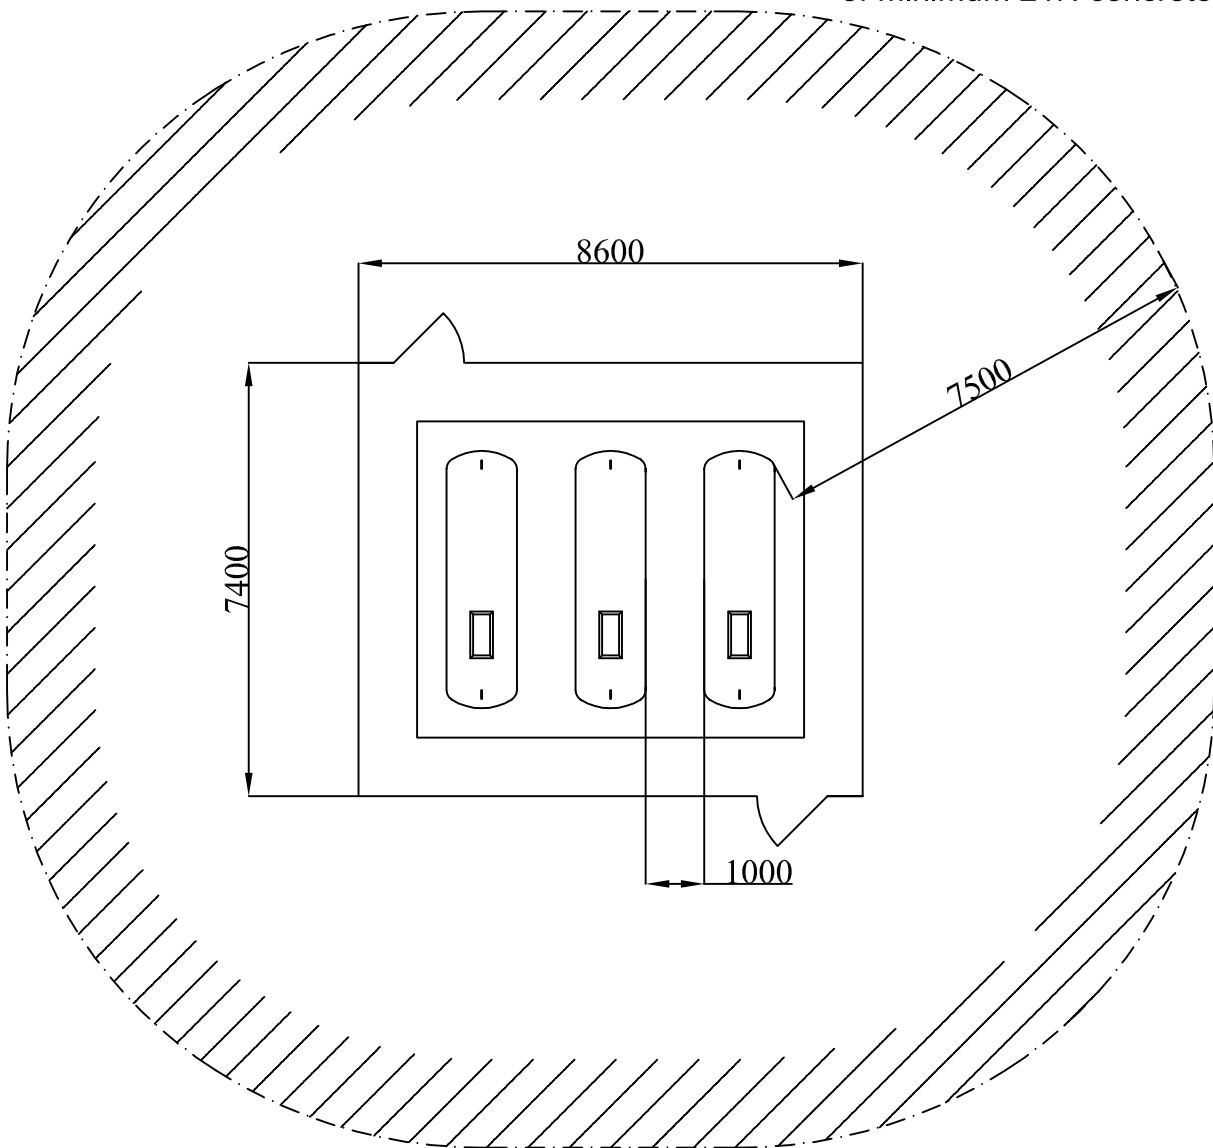

Concrete base, to be constructed of minimum 21N concrete.

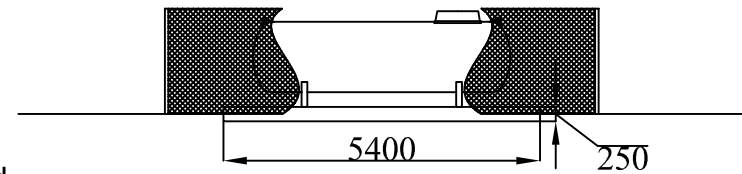

7.5m separation distance, no buildings, boundaries or fixed sources of ignition to be located in this area.

N.B. All dimensions in mm unless specified otherwise.

| | |
|-----------------|---|
| Name | Standard Installation with reduced compound |
| Description | 3no 2T bulk LPG vessels |
| Drawn By: | MRW |
| Checked By | |
| Date | 20/03/14 |
| Scale | NTS |
| Drawing No | 771 |
| Project No | N/A |
| Project Manager | N/A |
| Revision No | A |

