


EXTREME CAUTION. HIGH PRESSURE PIPELINE IN VICINITY! **RISK OF DEATH OR SERIOUS INJURY**
Prior to excavation starting you must contact the plant protection team on 02920 278912

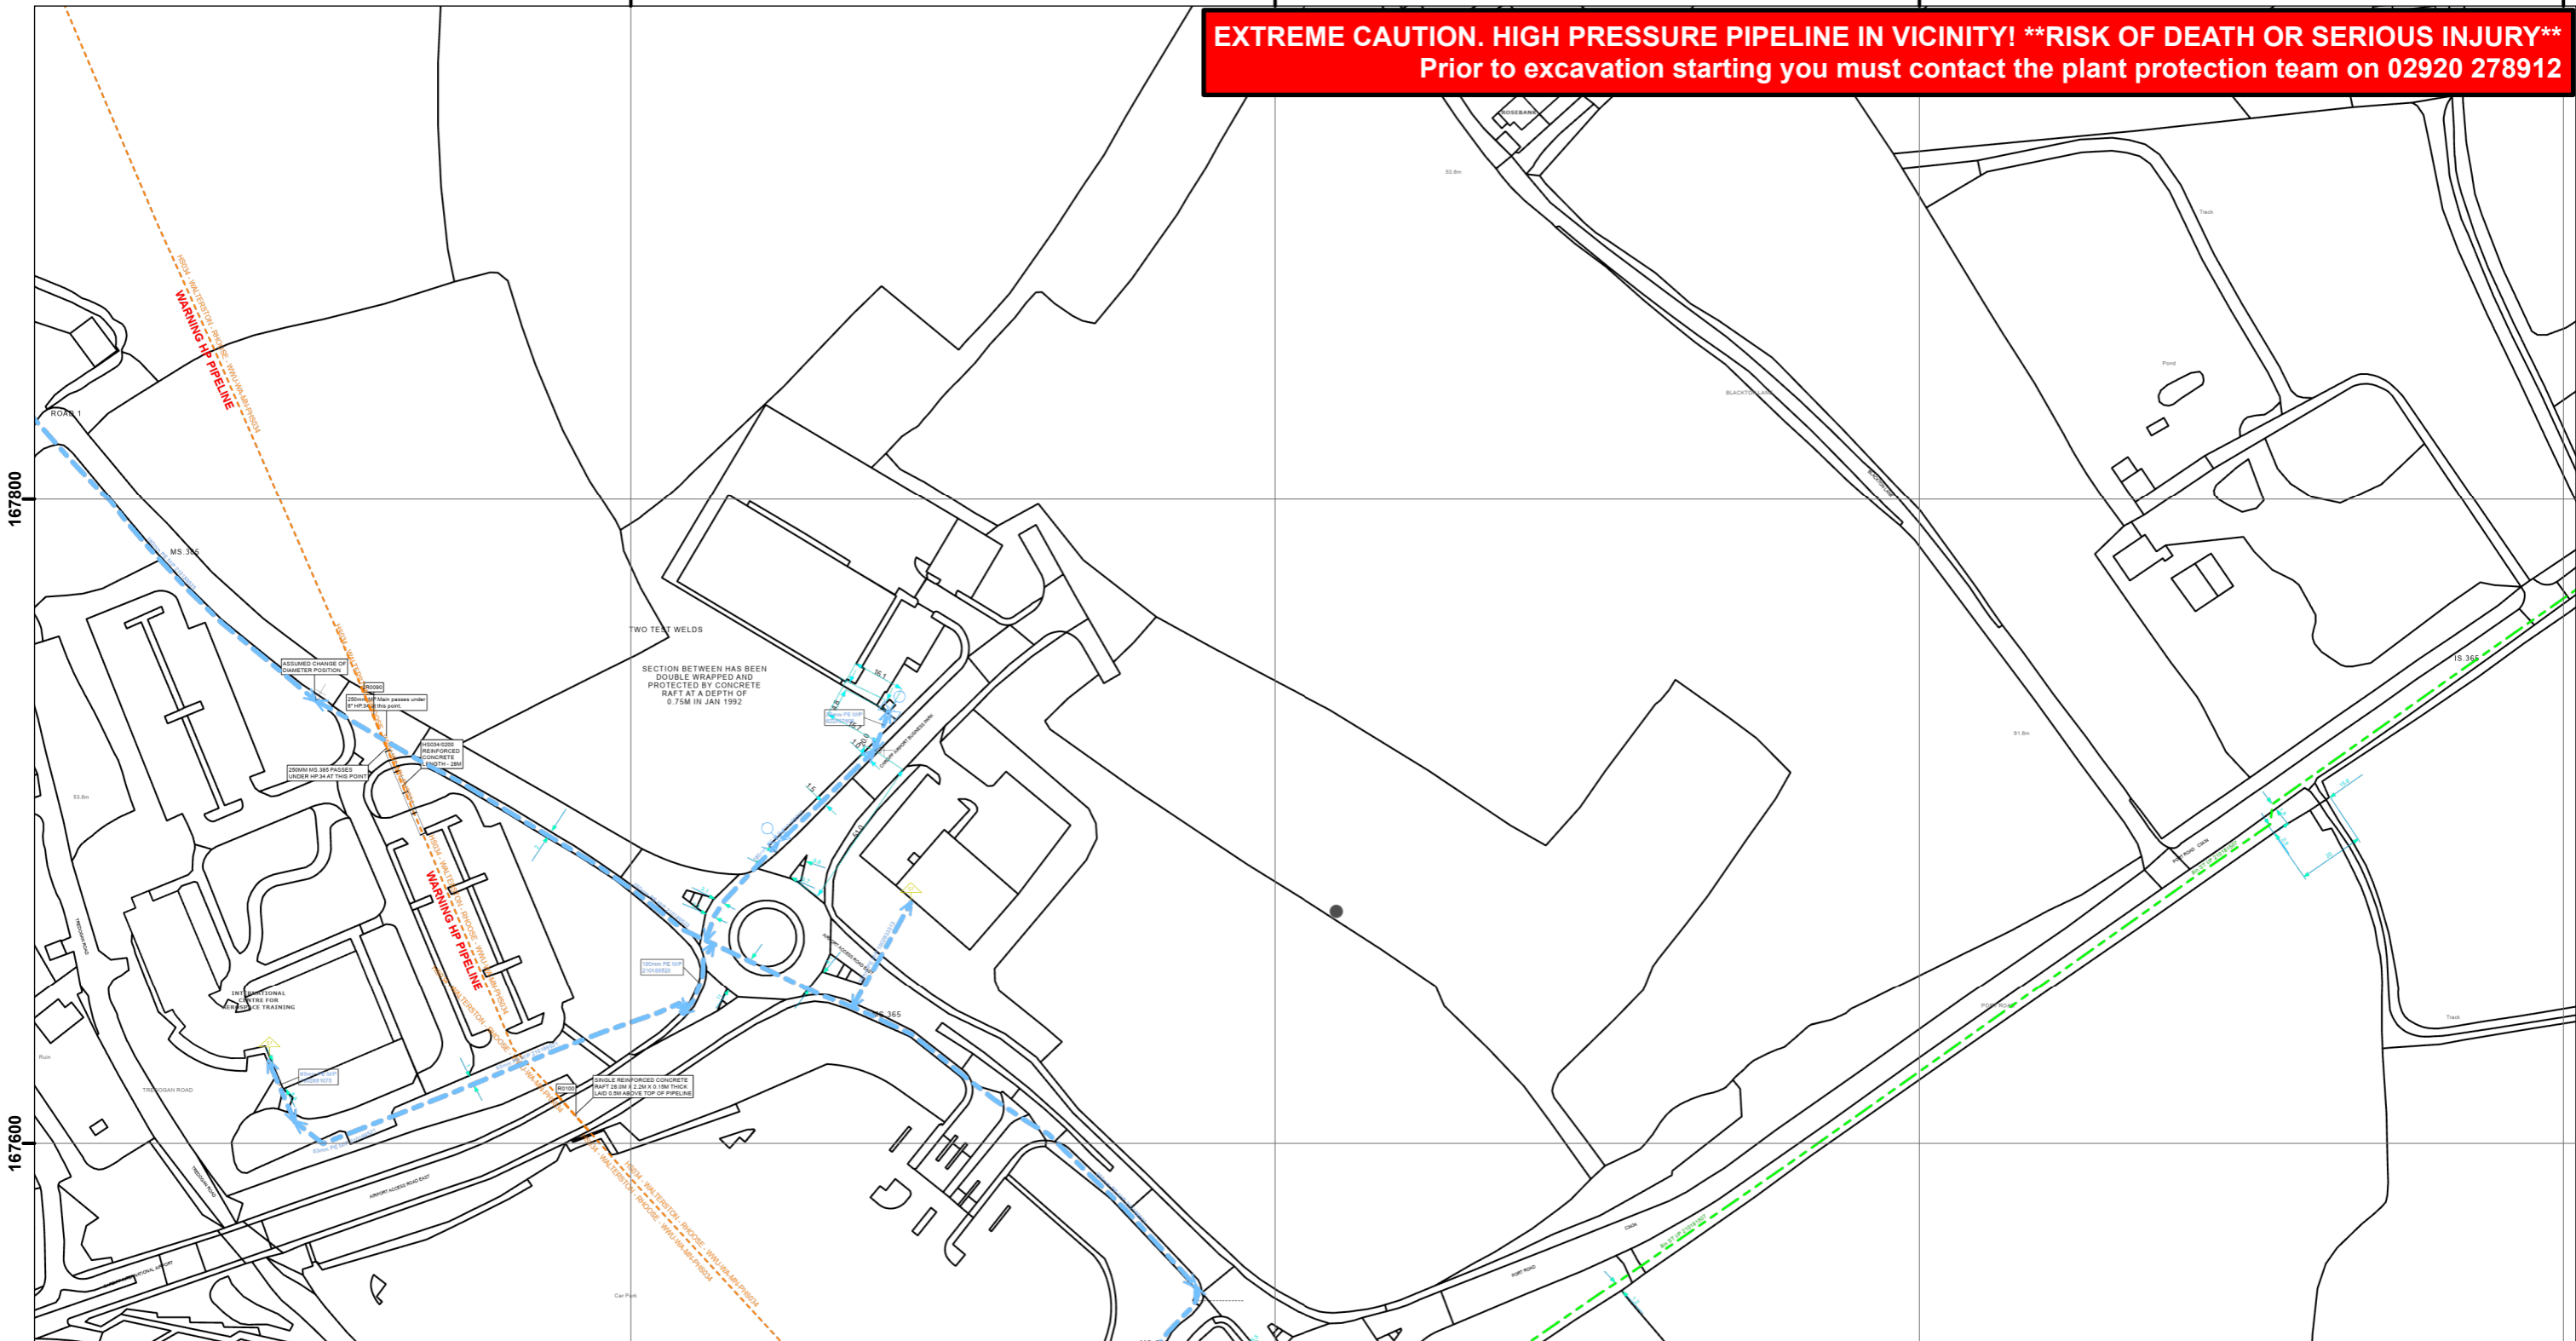

Reproduced by permission of Ordnance Survey on behalf of HMSO.
© Crown Copyright and database right 2024.
All rights reserved. Ordnance Survey Licence number 0100031673.

- Low Pressure (LP) 21mbar – 75mbar
- - - Medium Pressure (MP) 350mbar – 2bar
- . . - Intermediate Pressure (IP) 2bar – 7bar
- . . . High Pressure (HP) >7bar
- Line/Fire Valve
- Governor Station
- Change of Diameter
- End Cap
- Depth of cover

In case of an emergency call 0800 111 999

Warning: PDF designed for colour print only with no page scaling

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 278912

Title: 8150123899

Date Requested: 28/04/2024
 Job Reference:
 Site Location: Easting: 307409E Northing: 167746N
 Requested by:
 Your Scheme/Reference: Connections_A3_Landscape
 Exact Scales: 1:2,000 @A3

Smell gas?
Call the Gas Emergency Service on 0800 111 999.

Dial before you dig

We need 10 days' notice

- Dial**
Call 029 2027 8912 before you start work.
- Investigate**
Before you dig, make sure you know what's below.
- Go ahead**
Done your research? Now you can dig safely.